

# Exhibit to Agenda Item #11

SMUD Board of Directors Meeting

Tuesday, October 17, 2019 scheduled to begin at 9:00 a.m.

Customer Service Center, Rubicon Room



Powering forward. Together.




# What is the Pocket/Greenhaven 69kV Underground Cable Reliability Project?

---

- Replacing approximately 2 miles of underground 69kV cable
- Between I-5 along Florin Road towards Gloria Florin Substation and Havenside Canal Substation
- Up to 15 manholes
- Scheduled to begin November 2019 and take until late 2020

# Pocket/Greenhaven 69kV Underground Cable Reliability Project footprint

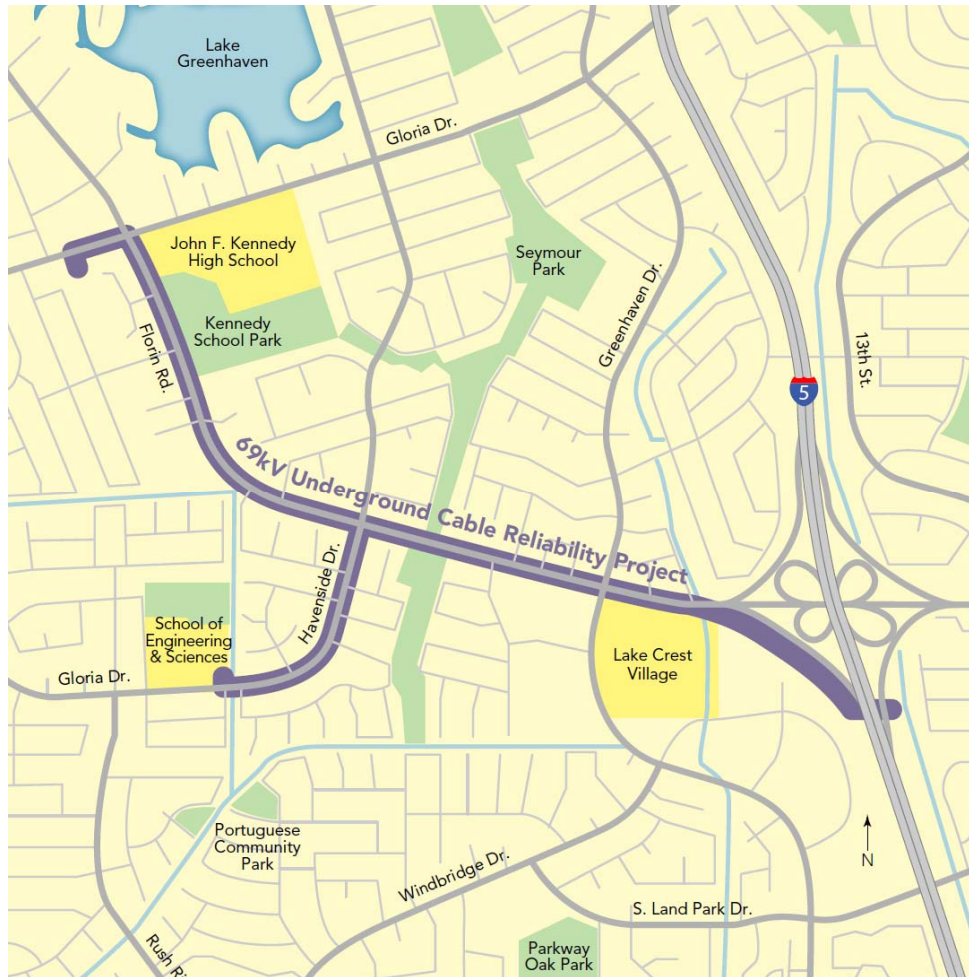

# Public Outreach Effort

---

- City of Sacramento
  - Florin Road Resurfacing Project
- 18,602 total letters sent
  - 14,095 letters describing 12 separate cable replacement efforts
  - 4,507 with NOI
- 4 hand delivered customer meeting invites
  - 1 customer meeting

# CEQA Impact Evaluation and Mitigation

---

- All potentially significant impacts will be reduced to **less than significant** levels with mitigation
- Mitigation measures cover the following impacts:
  - Air Quality
  - Biological Resources
  - Cultural Resources
  - Traffic and Transportation
  - Tribal Cultural Resources

# Pocket/Greenhaven 69kV CEQA Process

---

- Notice of Intent, August 7, 2019
  - 30 day public review; Over 4,507 letters sent to the public- 6 comments received
    - 3 customer comments
    - 3 agency comments
- Public Meeting, August 21, 2019
  - 25 attendees from the public
- Final Initial Study and Mitigated Negative Declaration published October 8, 2019
  - All comments were addressed in the Final IS/MND

## Requested Board Action

---

1. Adopt the California Environmental Quality Act Initial Study/ Mitigated Negative Declaration for the Pocket/Greenhaven 69kV Underground Cable Reliability Project;
2. Adopt the Mitigation Monitoring Reporting Plan; and
3. Approve the Project

# Questions or Comments?

---

