


# Exhibit to Agenda Item #2

Discuss approving Contract Change No. 1 to Contract No. 4600001985 with **W.A. Chester America, LLC**, to increase the contract not-to-exceed amount by \$1 million, from \$2 million to \$3 million, to repair the 115kV Station E to Station G Line 1 Underground High-Pressure Oil Filled (HPOF) cable fault.

Board Finance & Audit Committee and Special SMUD Board of Directors Meeting  
Tuesday, June 17, 2025, scheduled to begin at 6:00 p.m.

SMUD Headquarters Building, Auditorium

# Overview of Repairs & Timeline

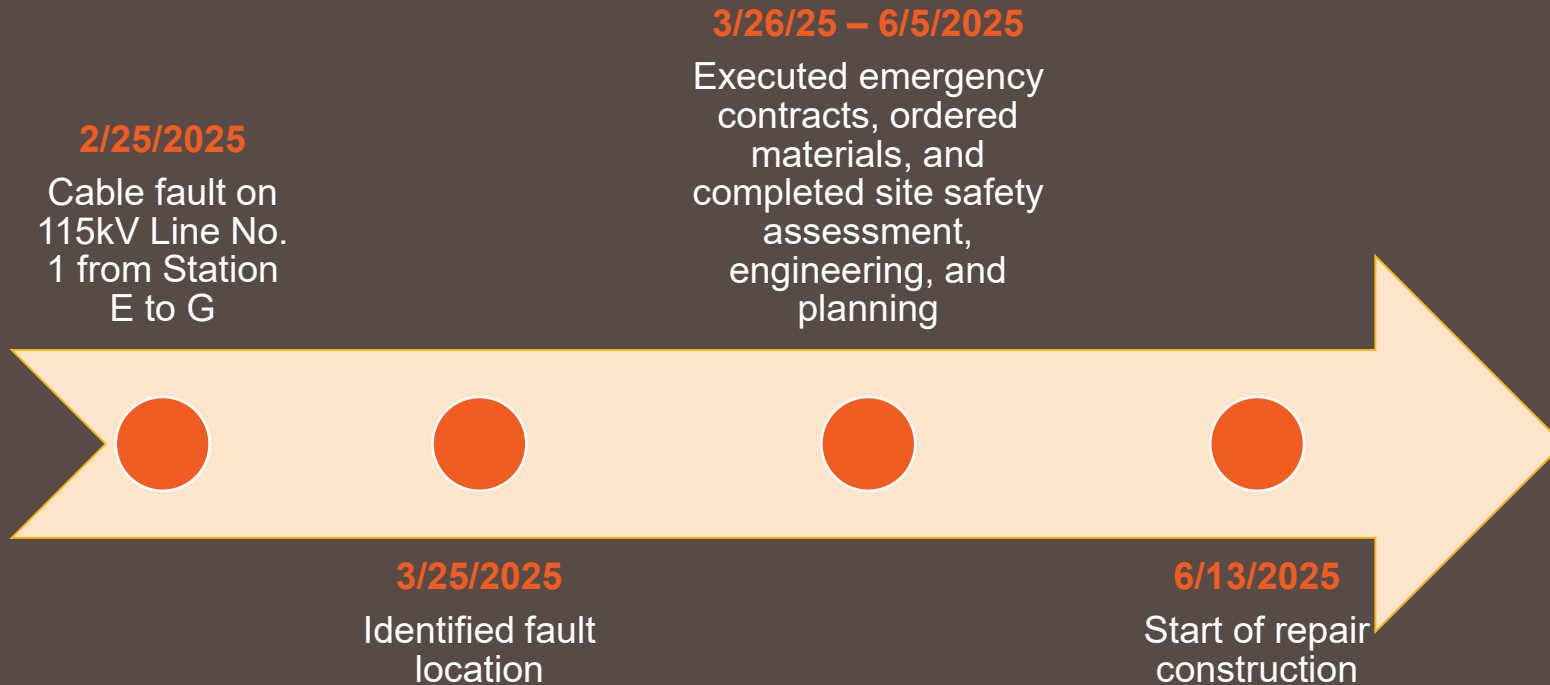

Basement of Station G Line 1 cable transition joint failure

# 115kV Transition Joint at STG Basement

- Misalignment issues caused stress on the transition joint which led to the failure.
- As part of the 6/13/2025 transition joint repairs, the vendor will address the alignment issue.
- Anticipate all repairs and testing to be completed by 7/18/2025 and Line 1 back in service.



Transition Joint Line 1 Fault in Basement of Station G